VERTICAL TURBINE PUMPS

Peerless Pump
A Sterling Company

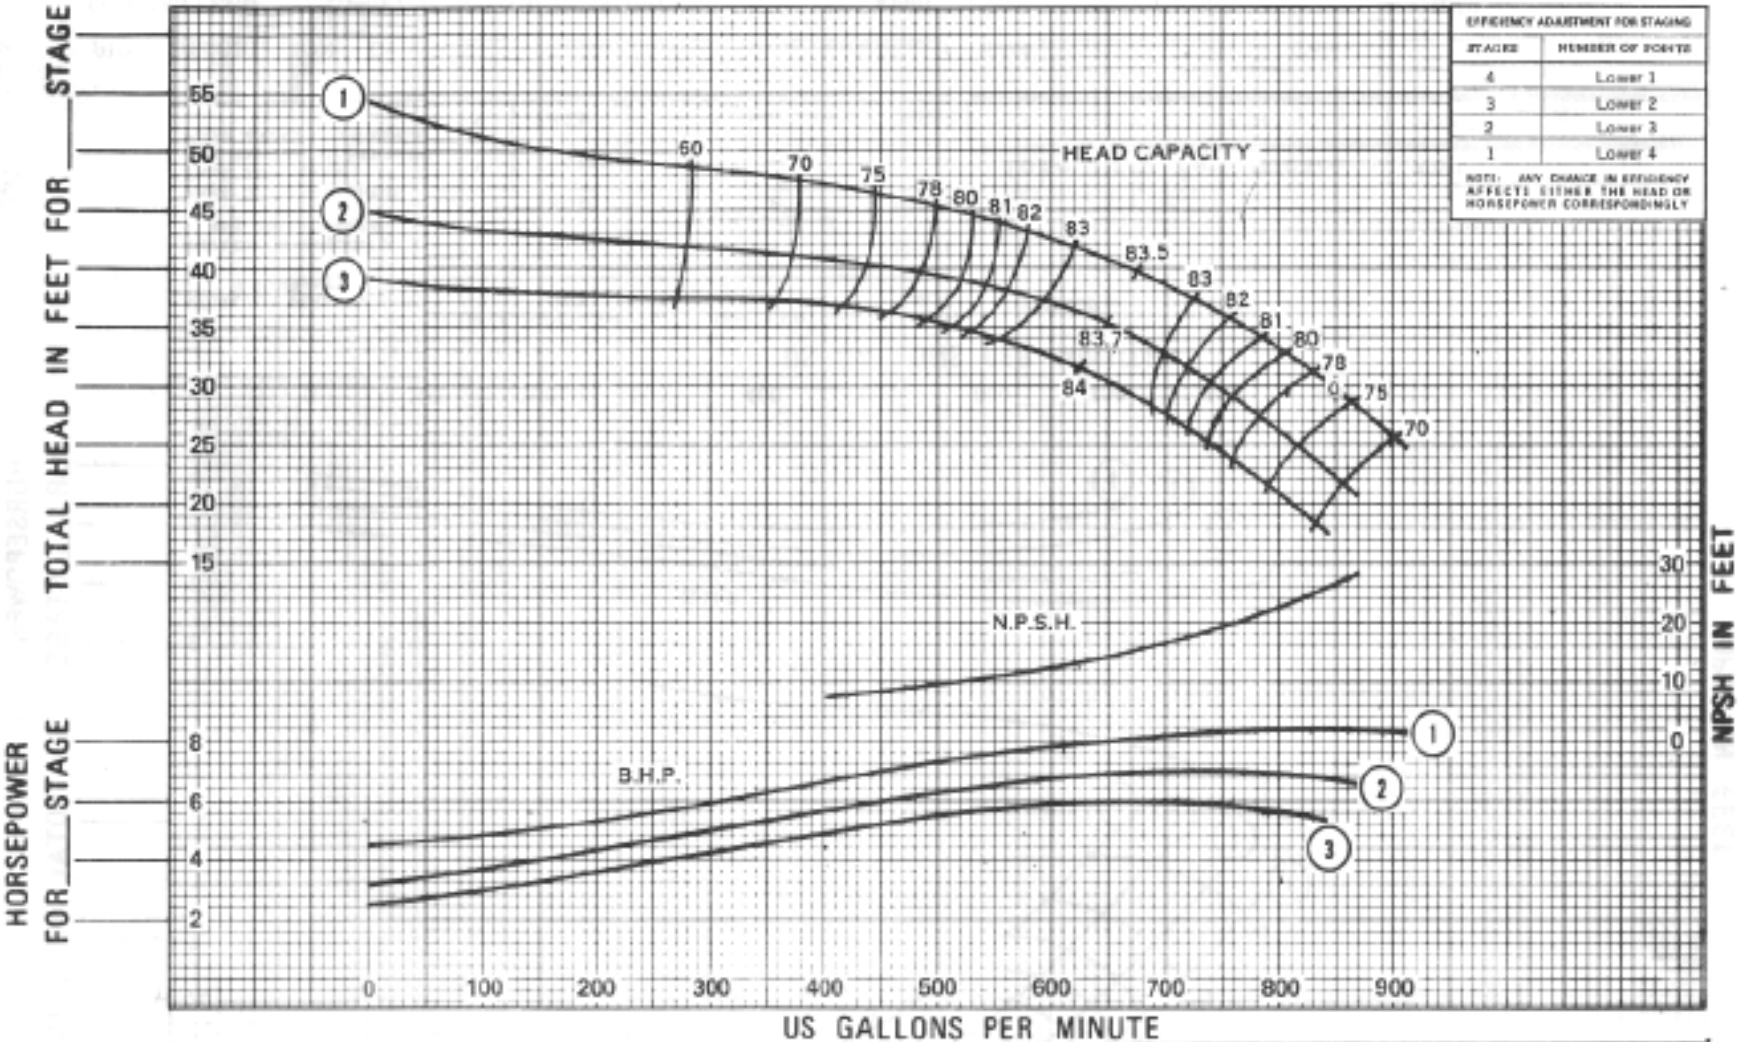

EFFICIENCY ADJUSTMENT FOR STAGING	
STAGES	NUMBER OF POINTS
4	Lower 1
3	Lower 2
2	Lower 3
1	Lower 4

NOTE: ANY CHANGE IN EFFICIENCY AFFECTS EITHER THE HEAD OR HORSEPOWER CORRESPONDINGLY

HYDRAULIC PERFORMANCE WARRANTY	CURVE NO.	IMPELLER NO.	IMPELLER DIA.	TAKEN FROM
Guaranteed at designated point only, and contingent on:	1	2624268	7-1/8"	58416
Proper flow to pump suction	2	2624238	6-7/8"	58836
Proper submergence Fluid free of gas, air & abrasives Proper lateral setting of impeller	3	2624288	6-5/8"	58921
	4			

Customer _____

Item _____

Peerless Ref. No:

Laboratory Performance | BOWL T-84232-C.I.E.

SIZE 10MA | RPM 1760 | CURVE 4806250

PUMP DESCRIPTION: Driver _____; Head _____; Column _____

GUARANTEED BOWL ☐ FIELD ☐ PERFORMANCE: Capacity _____ gpm; Head _____ ft; Eff _____ %; BHP _____